

IQVISION 2.10[R]

FileEditSearchBookmarksToolsWindowPx ViewerHelp

Quick Search

My Host: BMS-DESKTOPPC (Template19_01_17) : Station (Template19_01_17) : Files : px : Projects : KitPx4nsvg Style Website : Heat Recovery Unit.px

Wb Px View

homeBackForwardRefreshLegend

Site Name - KitPX4nsvg Templates

LogoffAlarm Console8/2/2018 15:0OAT22.6 °C

Recirc AHU

Recooperator AHU

Supply Extract AHU

Supply Extract AHU cw Reheats

Supply Extract Dual Fans 1

Thermal Wheel AHU

Heating System 1

Heating System 2

Heat Recovery Unit

Chilled Water System 1

Chilled Water System 2

Cooling Towers

Chiller

Extract Fans

Fuel System

Terminal Units


Water tanks


Heat Recovery Unit


14.0 %

User Adjustments


Control Enable	On
Control Times	Occupied
Control Mode	Auto
Trace Heating	Fault

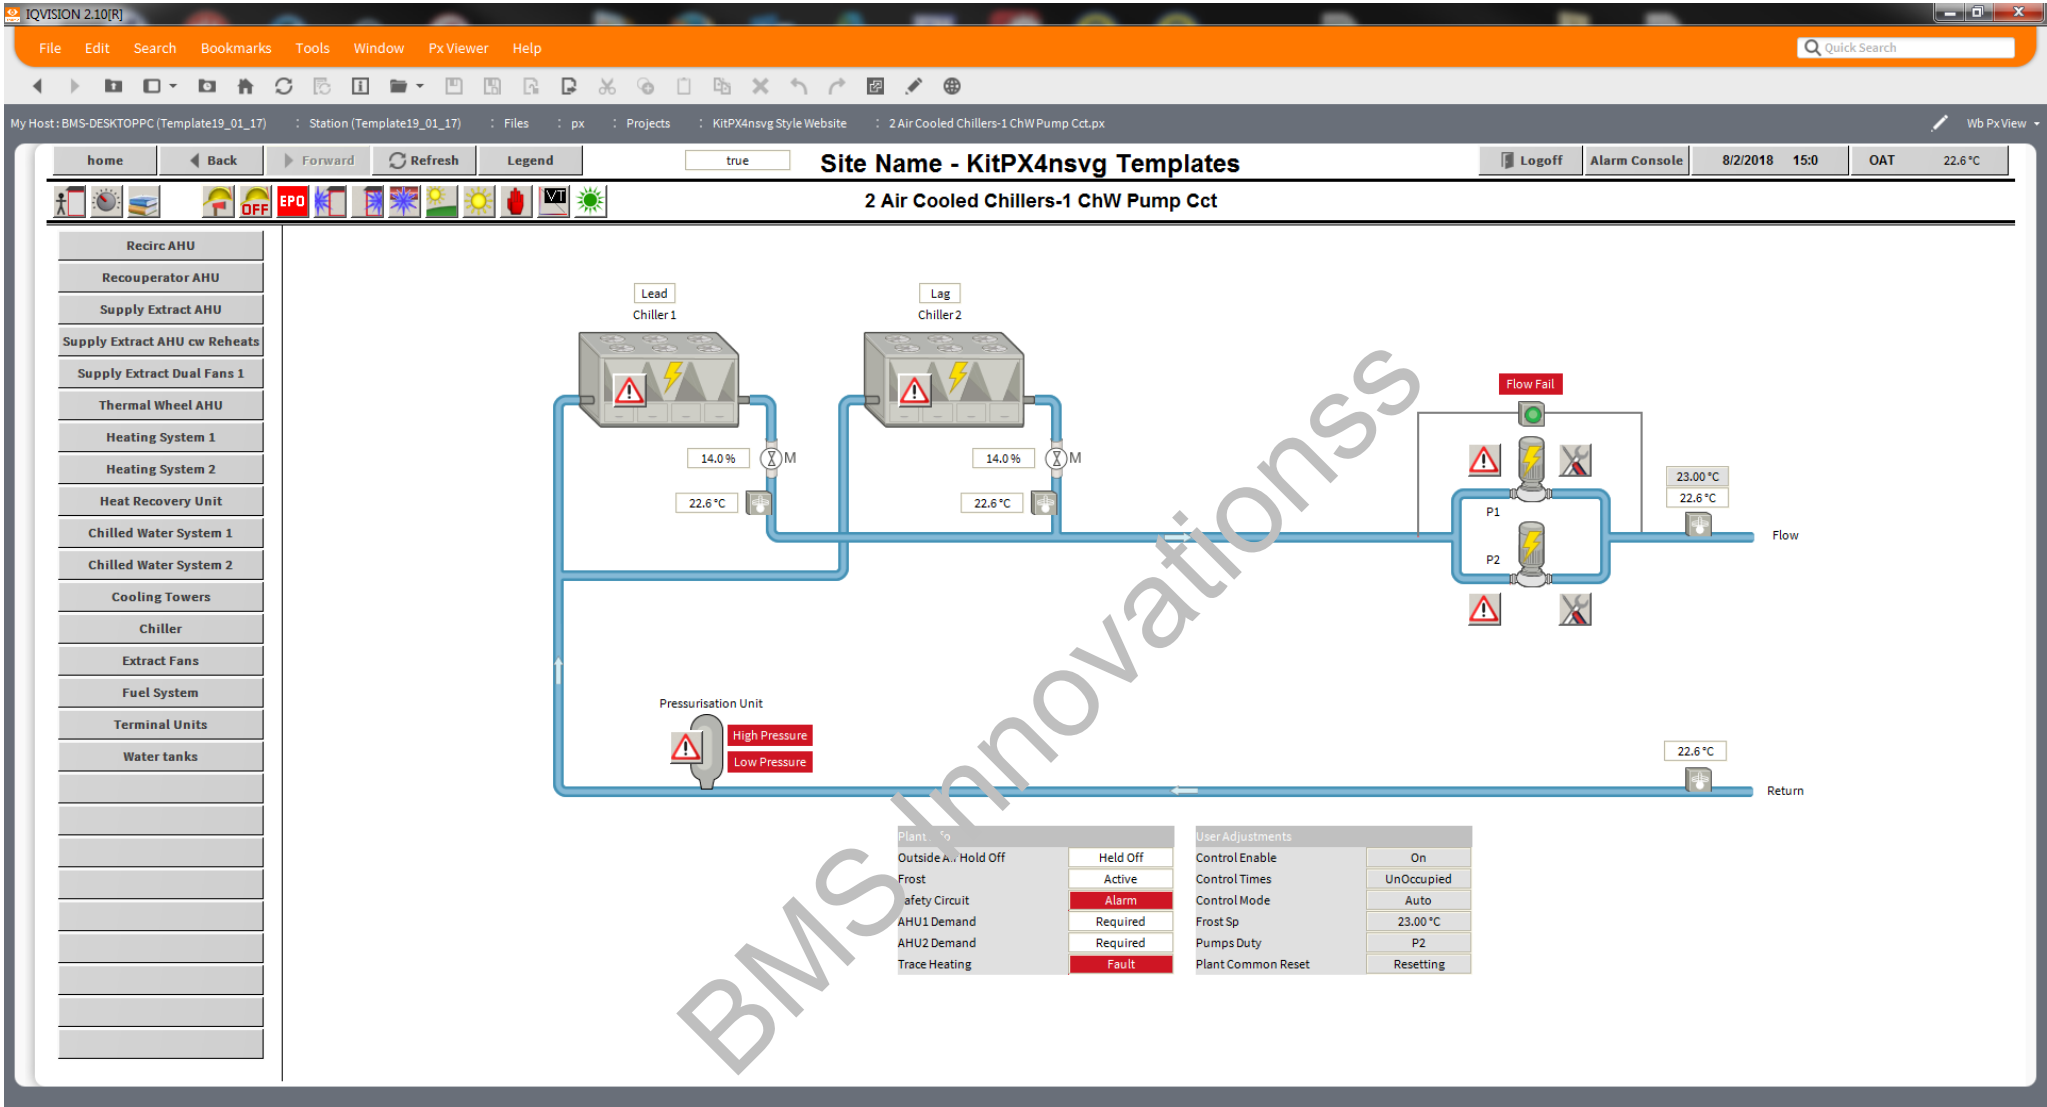

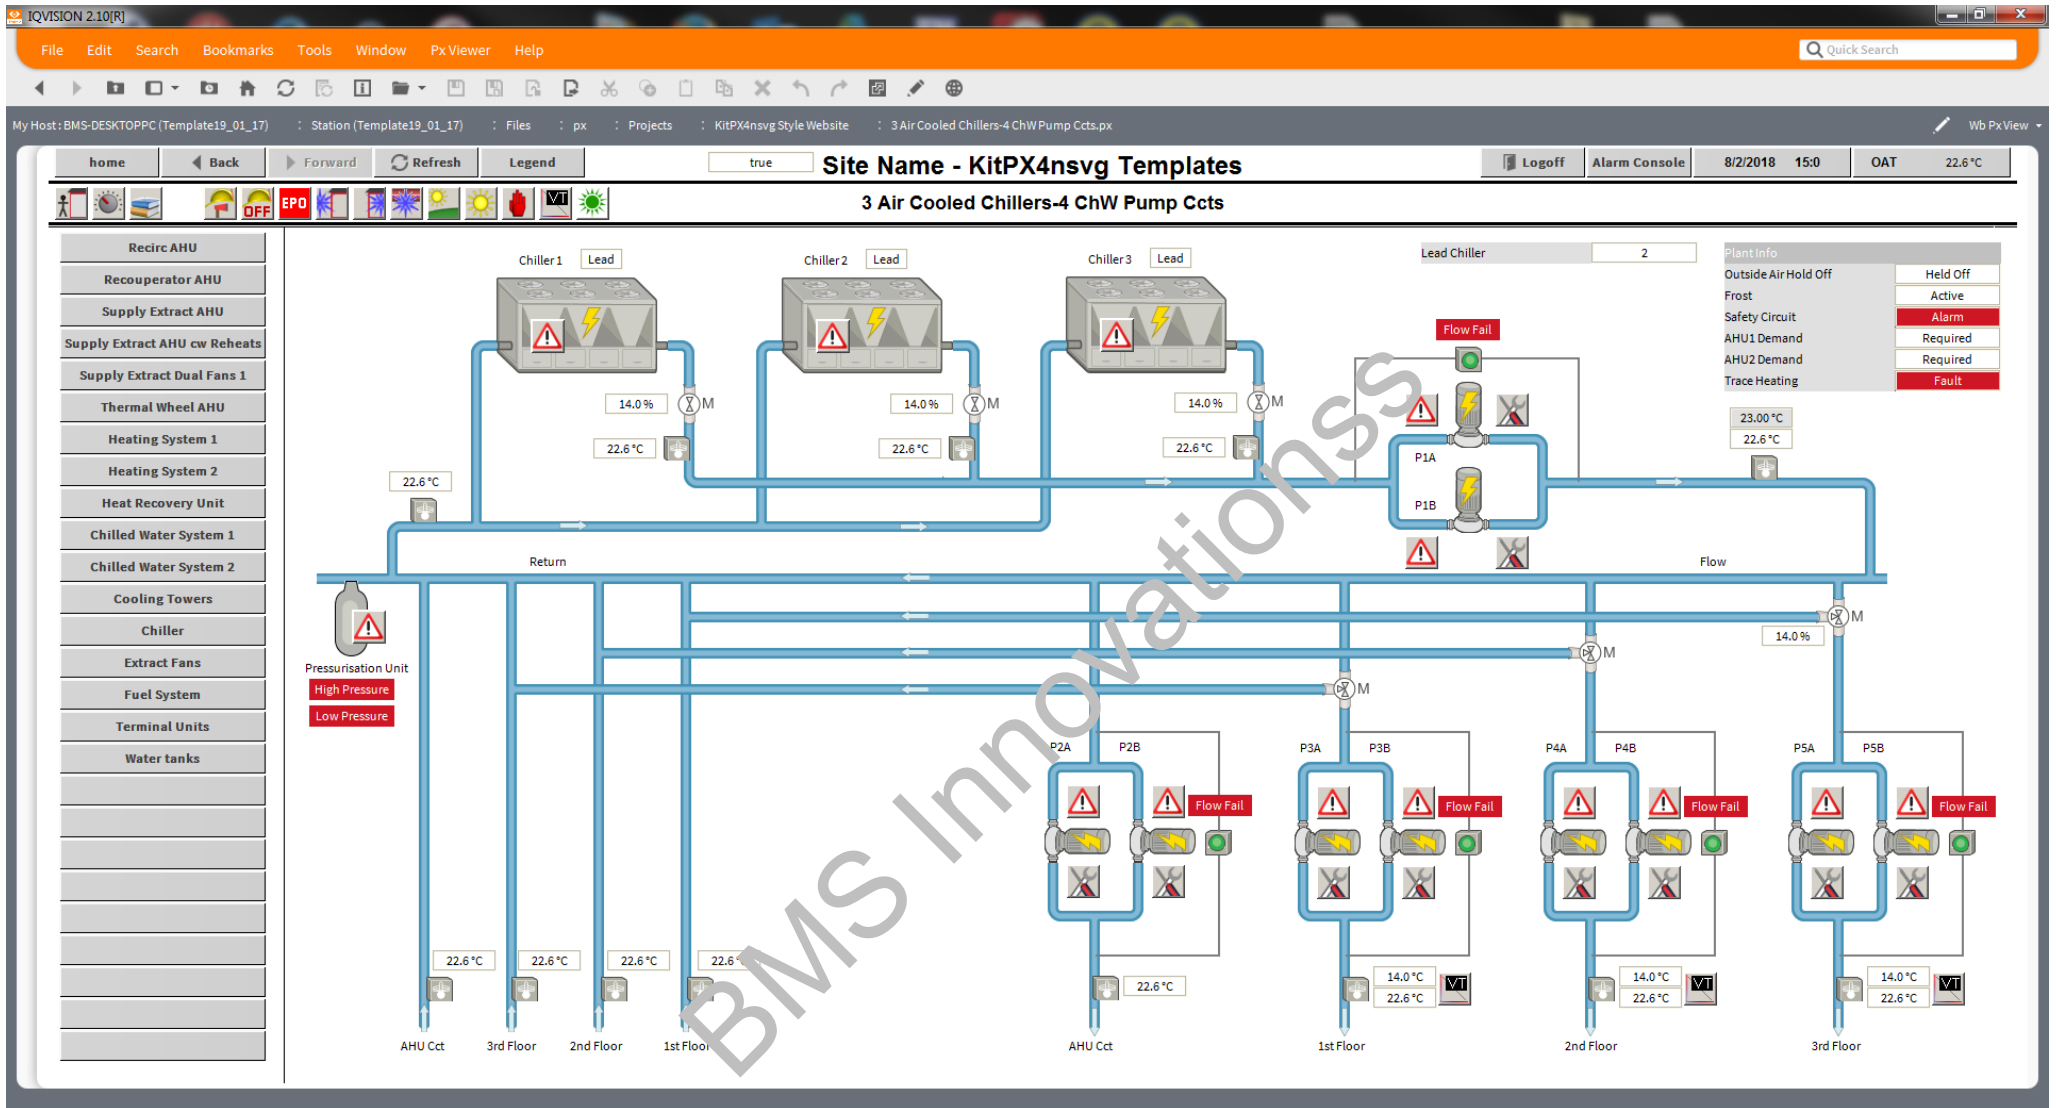

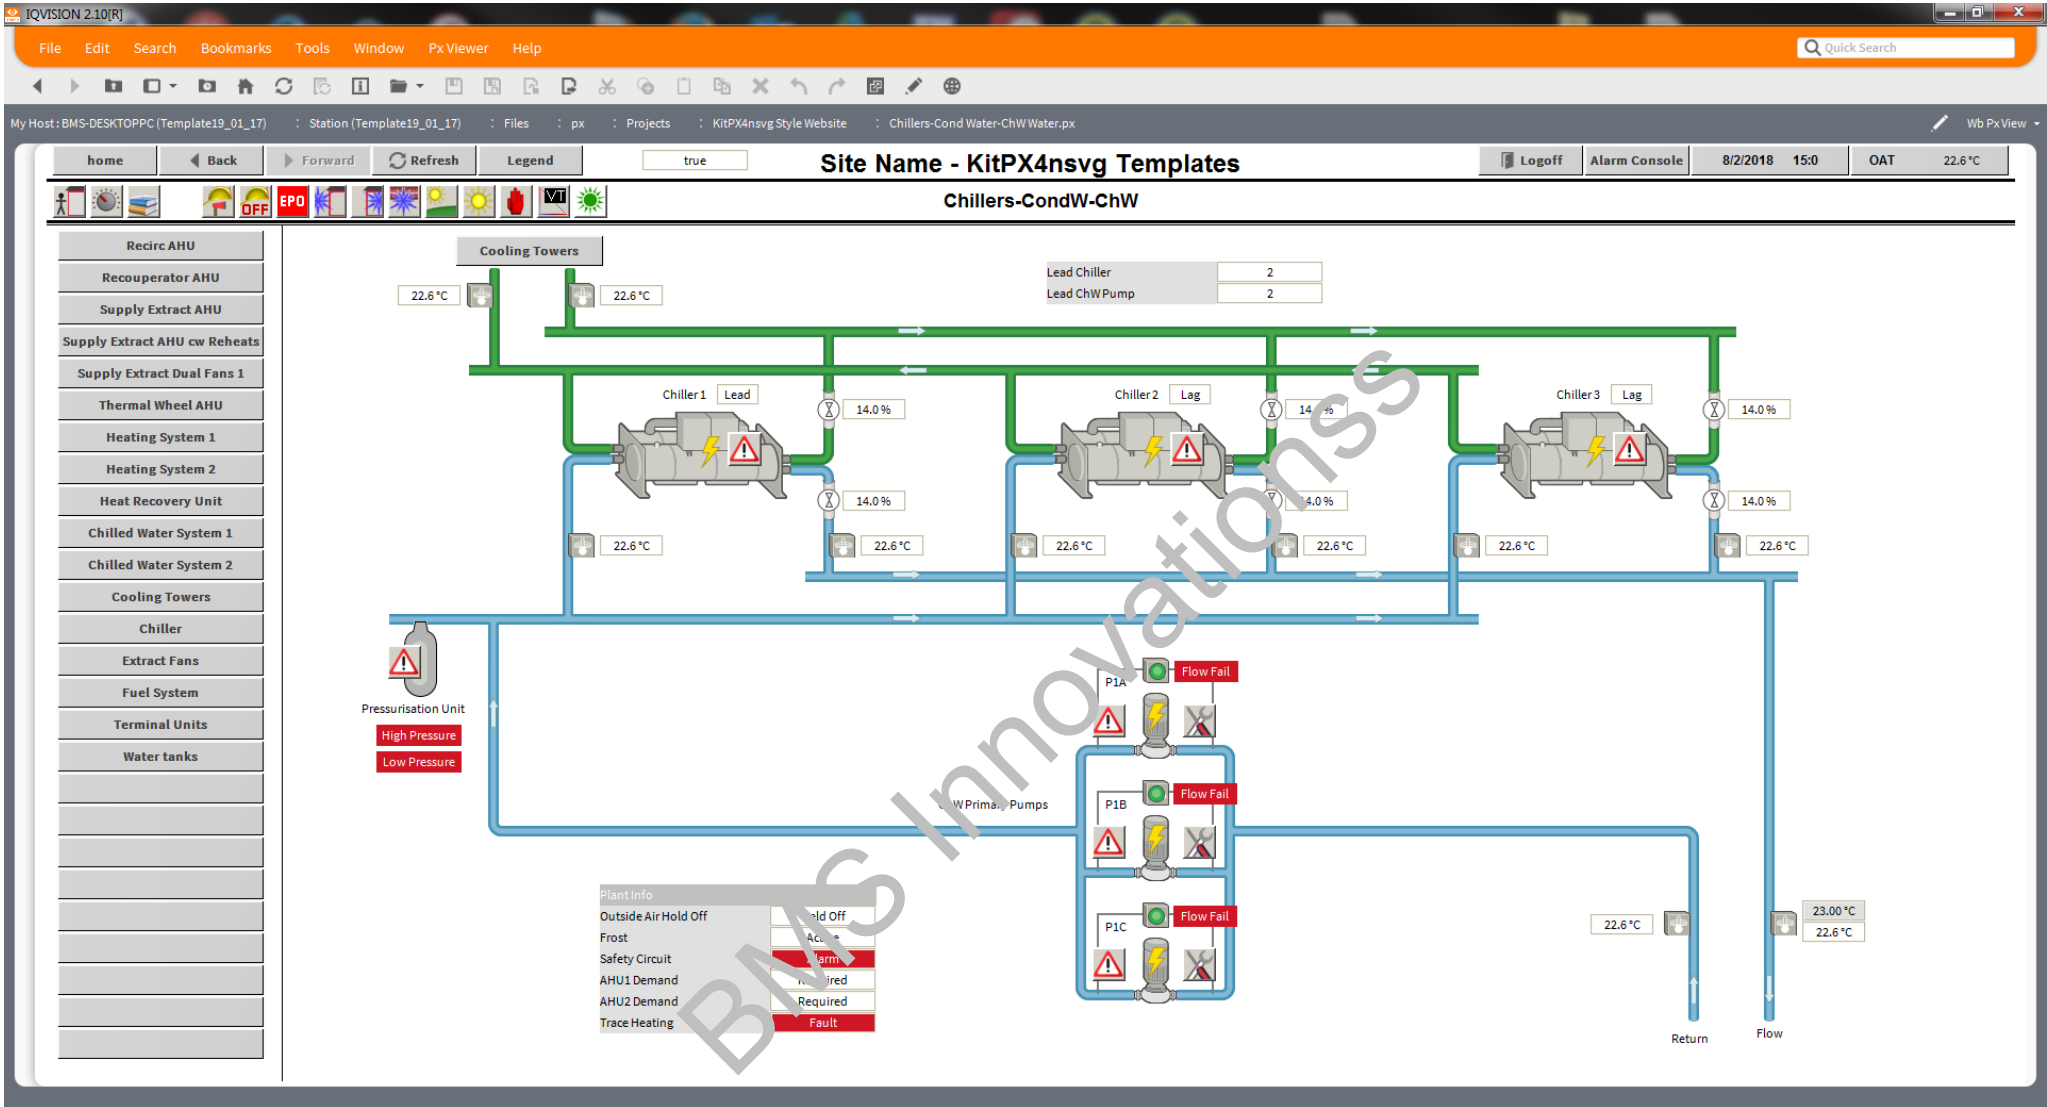

[illegible]

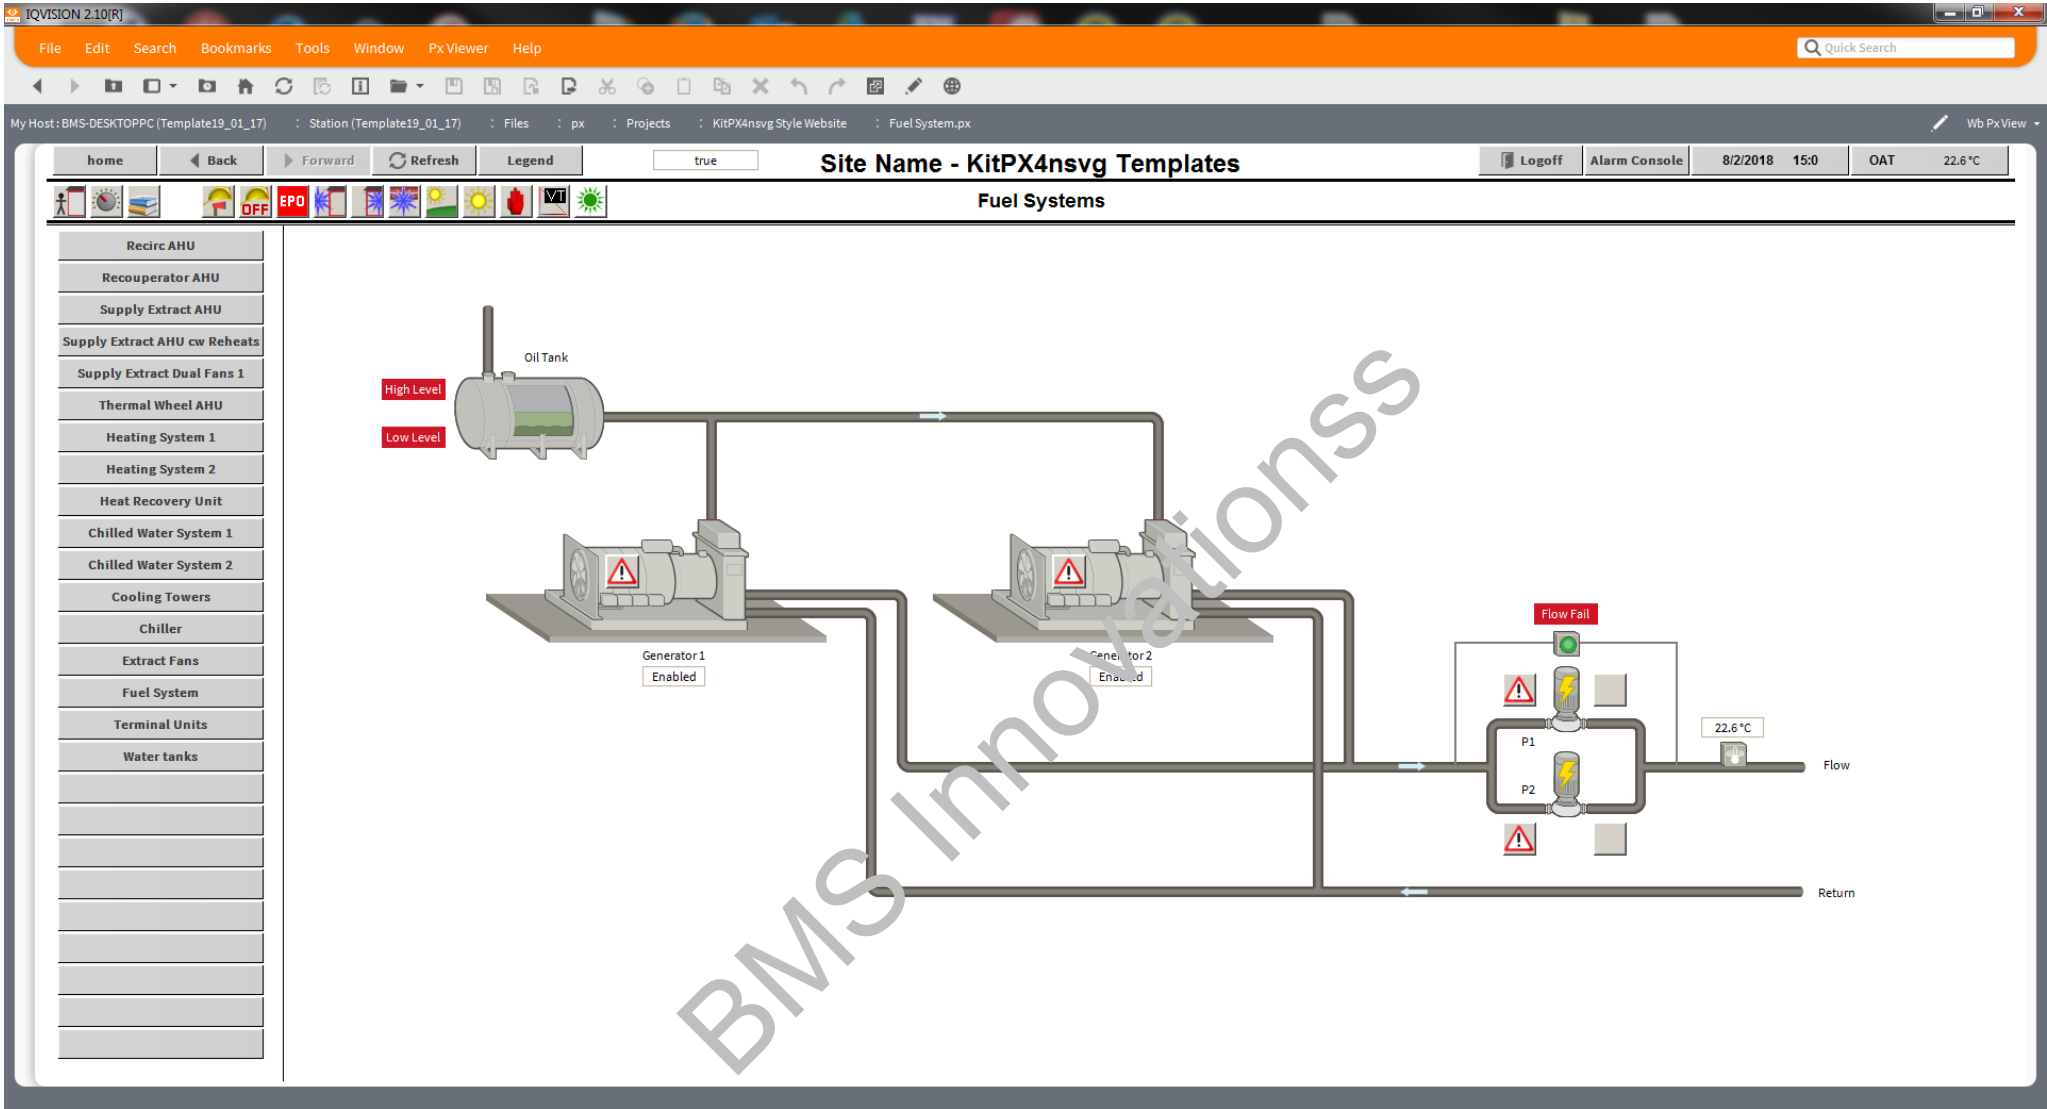

IQVISION 2.10[R]

FileEditSearchBookmarksToolsWindowPx ViewerHelp

Quick Search

My Host: BMS-DESKTOPPC (Template19_01_17) : Station (Template19_01_17) : Files : px : Projects : KitPX4nsvg Style Website : Terminal Units.px

Wb Px View

homeBackForwardRefreshLegend

Site Name - KitPX4nsvg Templates

LogoffAlarm Console8/2/2018 15:0OAT22.6 °C

Recirc AHU

Recooperator AHU

Supply Extract AHU

Supply Extract AHU cw Reheats

Supply Extract Dual Fans 1

Thermal Wheel AHU

Heating System 1

Heating System 2

Heat Recovery Unit

Chilled Water System 1

Chilled Water System 2

Cooling Towers

Chiller

Extract Fans

Fuel System

Terminal Units

Water tanks

Terminal Units

14.0 %

Terminal Unit

14.0 %

Terminal Unit / Fan

Terminal Unit

Terminal Unit

